

1

2












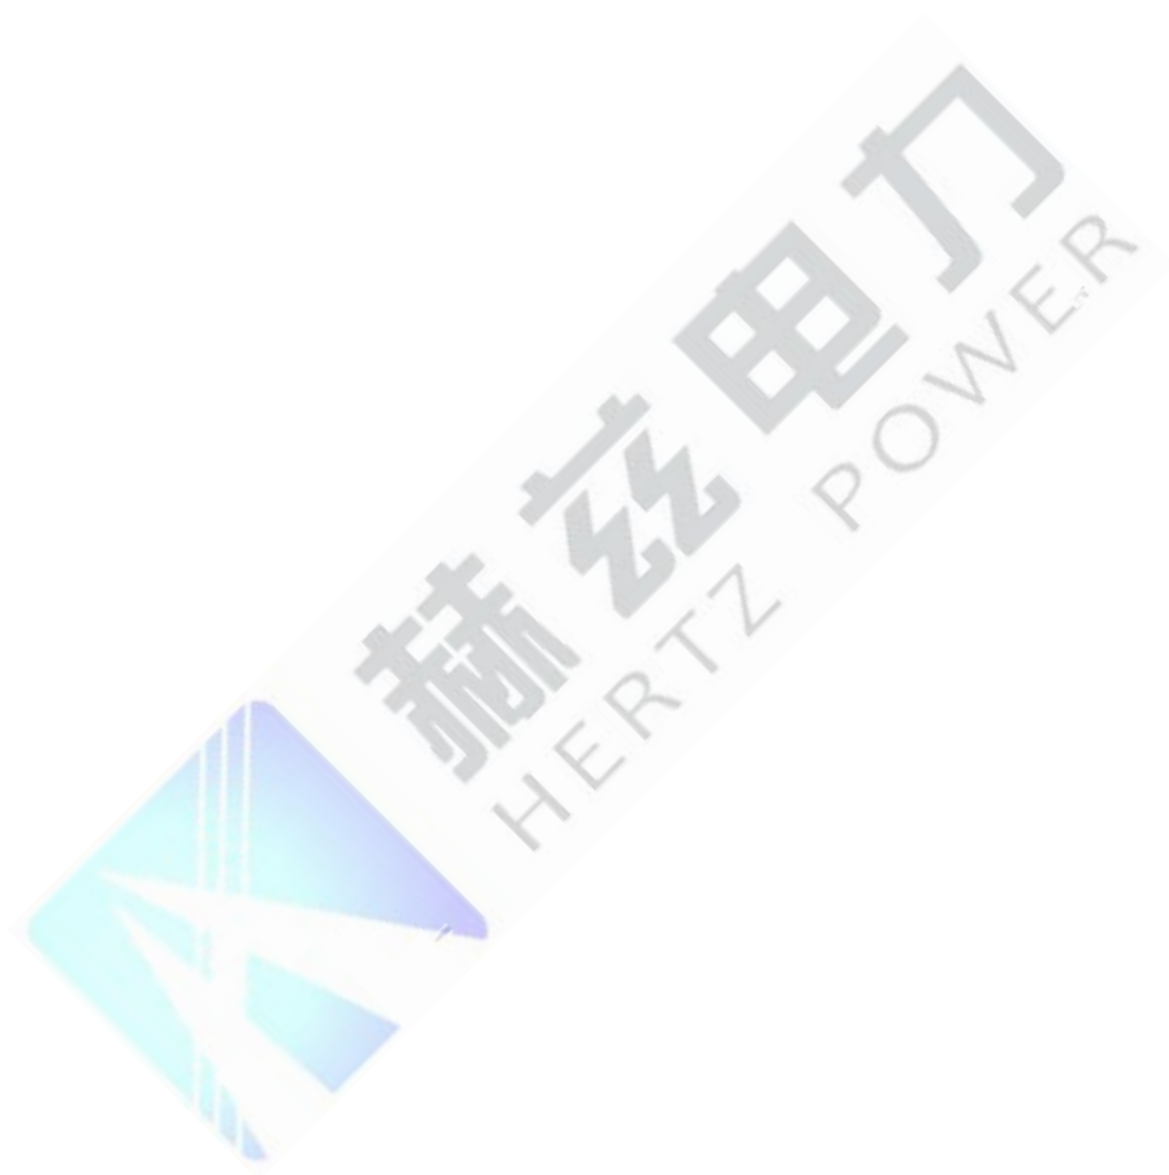
















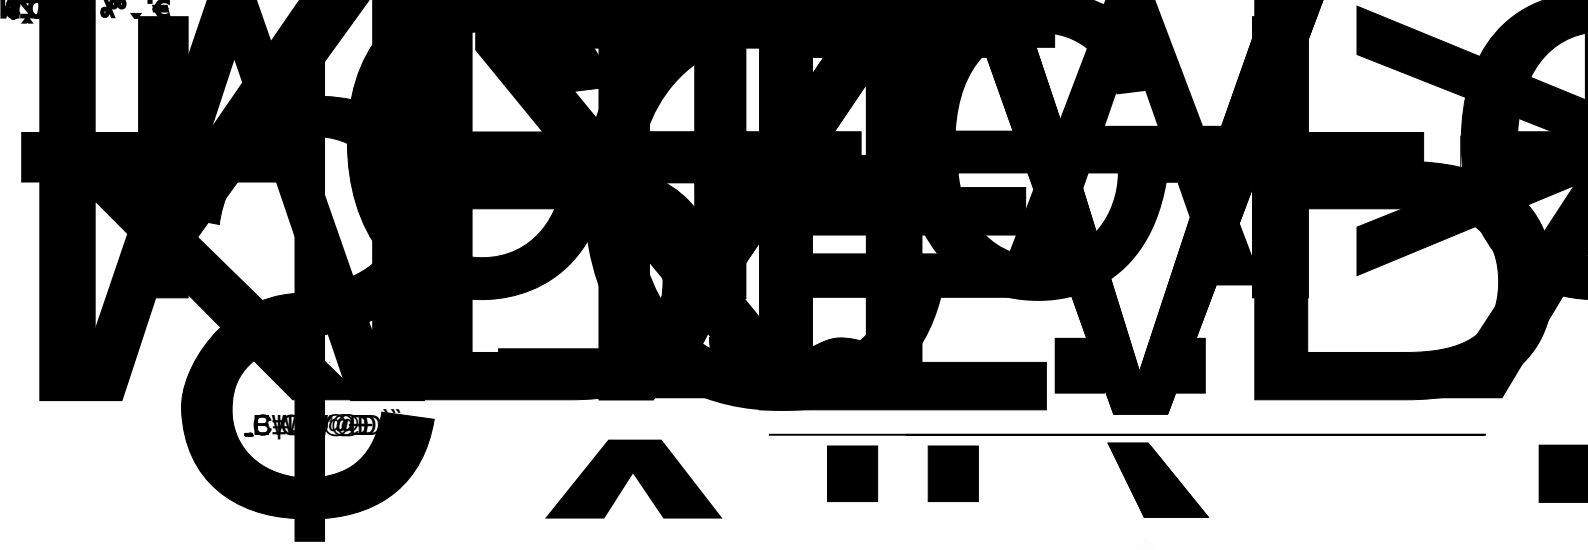


0

+0

0A





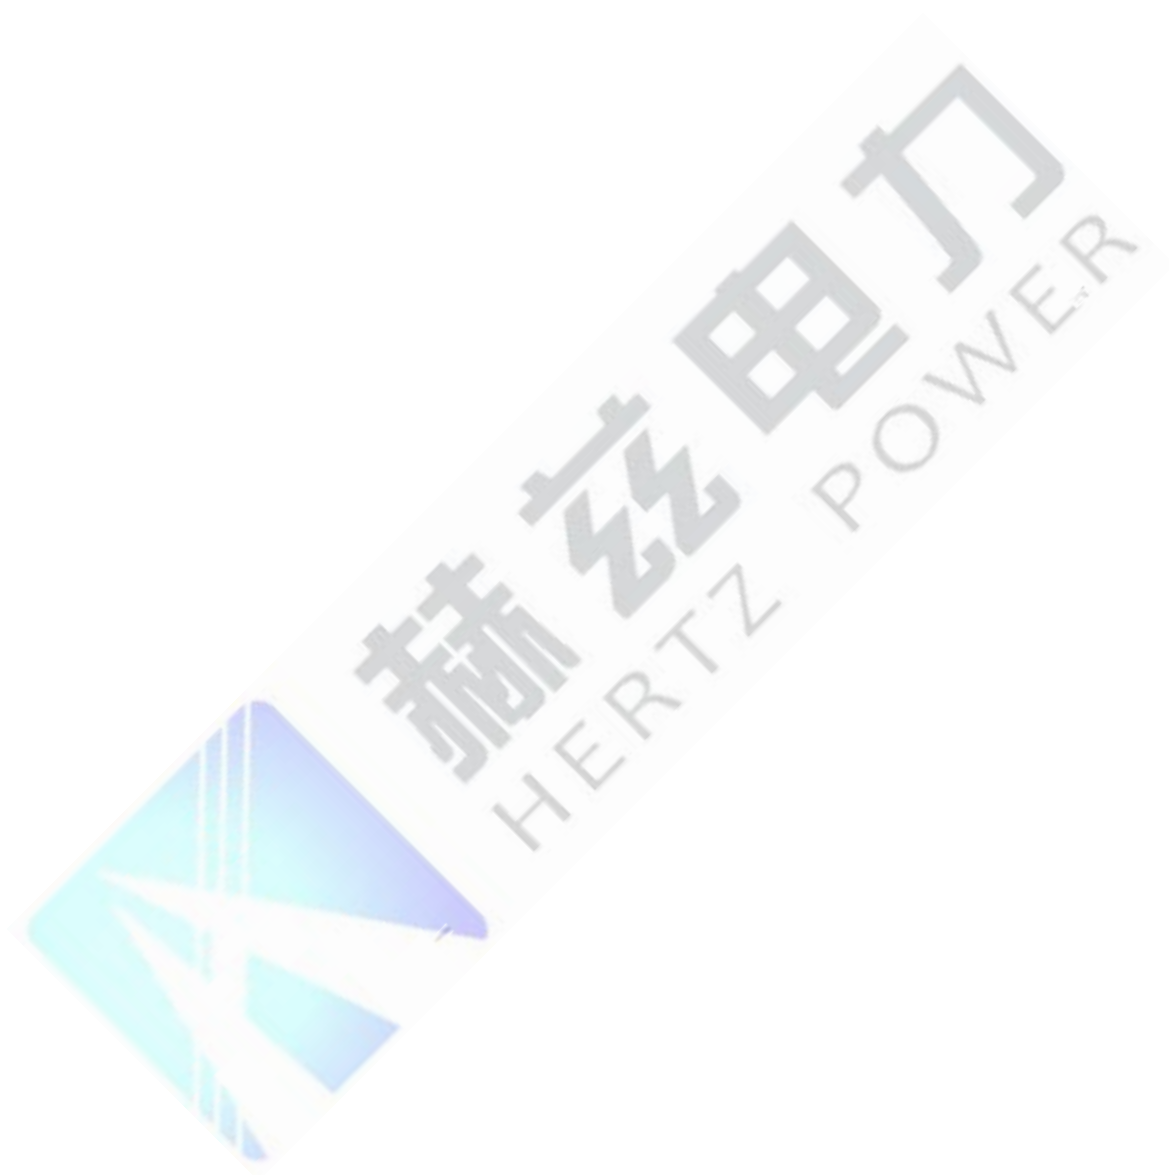

ES.









A B





A B

c
















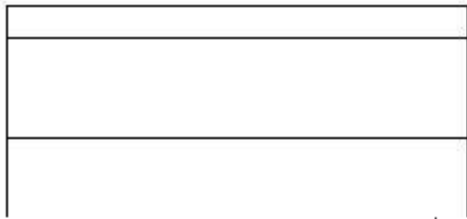


4n
发电机断路器操作箱



1n
发电机电气量保护

1FA
○
1YA
○

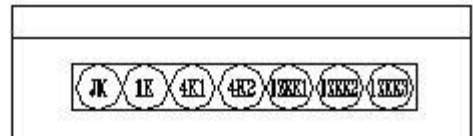

JK 1E 4E1 4E2 13E1 13E2 13E3



4n
发电机断路器操作箱



1n



1U1D
1U2D
1U3D
1VD
1W1D
1W2D



